

NANO-CERAMIC®

WWW.NANO-CERAMIC.COM INDUSTRIAL PROTECTIVE COATINGS

Test Report EN 1504-2



TECHNICKÝ A SKÚŠOBNÝ ÚSTAV STAVEBNÝ, n. o.
Test laboratory
Studená 3, 821 04 Bratislava



Laboratory branch in: Štefánikova 24, 059 41 Tatranská Štrba, Slovak Republic, tel. +421-52-4484 471, fax: +421-52-4484 472, e-mail: kazar@tsus.sk

TEST REPORT No. 90-14-0025

JOB

No.: 90130243
Client: PT NANO CERAMIC INDONESIA
The Central 88, Kemayoran, (The Linq)
Jl. Trembesi Blok D3 NO. 378
14410, Pademangan, Jakarta
Indonesia

OBJECT OF TESTING

Product: **Permanent Coating System (PCS) CONCRETE**
- coating for principles 1, 5, 6 - methods 1.3, 5.1, 6.1 of EN 1504-2
Manufacturer: manufacturer is the client
Standard of product: EN 1504-2: 2004 Products and systems for the protection and repair of concrete structures. Definitions, requirements, quality control and evaluation of conformity. Part 2: Surface protection systems for concrete

PRODUCT SAMPLE

Description of sample: Permanent Coating System (PCS) CONCRETE two-component coating material - component C1 in a can on the volume of 3000 ml, component C2 in a can on the volume of 400 ml
Designation of sample by client: Permanent Coating System (PCS) CONCRETE
Sampler: client
Place and date of delivery: Laboratory branch in Tatranská Štrba, on 23rd September 2017
Designation of sample by lab.: 173/13

TESTS

Preparation and coating: Permanent Coating System (PCS) CONCRETE was prepared and applied in accordance with the manufacturer's instructions. Components C1 and C2 of product were mixed in volume ratio 7,5 : 1. Coating was applied to clean and dry substrate, application by roller in a single layer.
The used substrates are specified below under the relevant tests.
Concrete substrates were prepared and cured according to EN 1766. The surface was sandblasted prior to treatment.
Determination of dry film thickness was carried out in accordance with EN 2808, wedge cut method.

Cross cut test - accredited test

Test procedure: EN ISO 2409: 2013 Paints and varnishes. Cross-cut test
Description of test specimens: one treated concrete slab with dimensions of 300 mm x 300 mm, thickness 50 mm, the coating applied to one face
- test substrate: concrete Type MC (0,40)
- application of coating: as described above
- curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by: Jozef Kukliš
Test conditions:
- laboratory environment
- using cutting tool: 1c
- distance of cuts: 4 mm according to EN 1504-2, Table 5

Test report No. 90-14-0025

Page No. 1 of 12

Deviations from the standard: none
Date of test: 14th November 2017
Test personnel: Jozef Kukliš

Carbon dioxide permeability - accredited test

Test procedure: EN 10626: 2003 Paints and varnishes. Coating materials and coating systems for exterior masonry and concrete. Part 6: Determination of carbon dioxide permeability
Description of test specimens: three treated circular test specimens with a diameter of 90 mm, the coating applied on one face
- test substrate: unglazed ceramic tiles with a thickness of 6 mm
- application of coating: as described on page 1
- curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity
- conditioning prior to testing: in accordance with EN 1062-11, Clause 4.3. (The test specimens were subjected to three cycles comprising 24 h storage in water at (23± 2)°C and 24 h drying at (50± 2)°C). Afterwards the test pieces were dried over desiccant to constant mass.)
- sealing compound: paraffin SASOLWAX 7837 (Manufacturer: Sasol Wax, Hamburg, Germany) mixed with refined crystalline paraffin
- In parallel, the diffusion resistance was determined against a CO2 reference film. Parallel measurement has been established without deviations from the predetermined tolerance.

Test specimens prepared by: Jozef Kukliš
Test conditions:
- method A: Gravimetric method
- exposed area of the test specimen **A** 0,005 m²
- time interval between two weighings of the test specimens 24 h
- used sodium hydroxide granulated for elemental analysis
- test temperature 23°C
- test concentration of carbon dioxide in chamber 10 % (V/V)
- mean barometric pressure during test p_{amb} 101,7 kPa
- the diffusion coefficient of carbon dioxide in air D_{CO_2} 1,38 m²/d
- the difference in concentration of carbon dioxide $|\Delta c|$ 180 g/m³

Deviations from the standard: none
Date of test: from 11th to 22nd November 2017
Test personnel: Jozef Kukliš

Permeability to water vapour - accredited test

Test procedure: EN ISO 7783: 2012 Paints and varnishes. Determination of water-vapour transmission properties. Cup method
Description of test specimens: three treated circular test specimens with a diameter of 90 mm, the coating applied on one face
- test substrate: unglazed ceramic tiles with a thickness of 6 mm
- application of coating: as described on page 1
- curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity
- conditioning prior to testing: in accordance with EN ISO 7783, method B (The test specimens were subjected to three cycles comprising 24 h storage in water at (23± 2)°C and 24 h drying at (50± 2)°C))
- sealing compound: paraffin SASOLWAX 7837 (Manufacturer: Sasol Wax, Hamburg, Germany) mixed with refined crystalline paraffin
Test specimens prepared by: Jozef Kukliš
Test conditions:
- measuring: wet cup method
- exposed area of the test specimen **A** 0,005 m²
- time interval between two weighings of the test specimens 24 h
- used saturated aqueous solution - NH₄H₂PO₄
- test temperature 23°C
- relative humidity in climate chamber 50%
- relative humidity in test cup 93%
- water vapour pressure difference Δp_v 1207 Pa
- standard barometric pressure p_0 1013,25 hPa
- mean barometric pressure during test p 1014,9 hPa
- gas constant of water vapour R_v 462 Nm/(kg.K)
- test temperature **T** 296 K
- water-vapour transmission rate of the substrate 409,6⁰ g/(m².d)

Deviations from the standard: none
Date of test: from 11th to 21th November 2017
Test personnel: Jozef Kukliš

Test report No. 90-14-0025

Page No. 2 of 12

Capillary water absorption and water permeability water - accredited test

Test procedure:	EN 1062-3: 2008 Paints and varnishes – Coating materials and coating systems for exterior masonry and concrete. Part 3: Determination of liquid water permeability
Description of test specimens:	three treated test specimens with dimensions of approximately 150 mm x 150 mm, thickness 30 mm, coating applied to one face - test substrate: calcium silicate bricks - application of coating: as described on page 1 - curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity - the reverse side and the edges of the test specimens were sealed with two layers of two-component epoxy varnish, subsequently drying for further 7 days at (23±2)°C and (50±5)% relative humidity - conditioning prior to testing: in accordance with EN 1062-3, Clause 6.4.2 (The test specimens were subjected to three cycles comprising 24 h storage in water at (23±2)°C and 24 h drying at (50±2)°C)
Test specimens prepared by:	Jozef Kukliš
Test conditions:	laboratory environment
Deviations from the standard:	none
Date of test:	from 7 th to 08 th November 2017
Test personnel:	Jozef Kukliš

Thermal change compatibility - Thunder-shower cycling (thermal shock) and Freeze-thaw cycling with de-icing salt immersion - accredited test

Test procedure:	EN 13687-2: 2002 Products and systems for the protection and repair of concrete structures. Test methods. Determination of thermal compatibility. Part 2. Thunder-shower cycling (thermal shock) EN 13687-1: 2002 Products and systems for the protection and repair of concrete structures. Test methods. Determination of thermal compatibility. Part 1: Freeze-thaw cycling with de-icing salt immersion
Description of test specimens:	two treated concrete slabs with dimensions of 300 mm x 300 mm, thickness 100 mm, the coating applied to one face - test substrate: concrete Type MC (0,40) - application of coating: as described on page 1 - curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity - all surfaces of the specimens except the 300 mm x 300 mm test face were sealed with thermosetting resin, subsequently drying for further 7 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by:	Jozef Kukliš
Test conditions:	Tests of the thermal change compatibility according to EN 13687-1 and EN 13687-2 were carried out on the same test samples pursuant to the requirements of EN 1504-2, Table 5. The test samples were subjected to 10 cycles of the thunder-shower and then to 20 cycles of the freeze-thaw cycling with de-icing salt immersion. One cycle of the thunder-shower took 6 h and comprised the following stages: - storage under radiant heat at (60±5)°C for 5 h and 45 min - dousing with water at a temperature of (12±3)°C for 15 min One cycle of the freeze-thaw cycling lasted for 4 h and comprised the following stages: - immersion in the tank containing saturated sodium chloride solution at a temperature (-15±2)°C for 2 h - storage in the water tank at a temperature of (21±2)°C for 2 h After every 10 cycles and after the end of the exposure was evaluated: - degree of blistering, method according to EN ISO 4628-2; - degree of cracking, method according to EN ISO 4628-4; - degree of flaking, method according to EN ISO 4628-5. 7 days after the end of the exposure was evaluated adhesion strength by pull-off test.
Deviations from the standard:	none
Date of test:	- exposure: from 14 th to 26 th November 2017 - pull-off test: 3 rd December 2017
Test personnel:	Jozef Kukliš

Thermal change compatibility – Freeze-thaw cycling without de-icing salt impact - accredited test

Test procedure:	EN 13687-3: 2002 Products and systems for the protection and repair of concrete structures. Test methods. Determination of thermal compatibility. Part 3. Thermal cycling without de-icing salt impact
Description of test specimens:	two treated concrete slabs with dimensions of 300 mm x 300 mm, thickness 100 mm, the coating applied on one face - test substrate: concrete Type MC (0,40) - application of coating: as described on page 1 - curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity - all surfaces of the specimens except the 300 mm x 300 mm test face were sealed with thermosetting resin, subsequently drying for further 7 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by:	Jozef Kukliš
Test conditions:	The test samples were subjected to 20 cycles of the freeze-thaw cycling according to EN 13687-3, Clause 7.2. One cycle took 24 h and comprised the following stages: - 2 h water storage at (21±2)°C - 3 h cooling with air at (-15±2)°C - 4 h storage at (-15±2)°C: - 15 min heating with water at (21±2)°C - 1 h 15 min water storage at (21±2)°C - 1 h 30 min heating air at (60±2)°C - 10 h air storage at (60±2)°C - 15 min cooling with water at (21±2)°C - 1 h 45 min water storage at (21±2)°C After 10 cycles and after the end of the exposure were evaluated: - degree of blistering, method according to EN ISO 4628-2; - degree of cracking, method according to EN ISO 4628-4; - degree of flaking, method according to EN ISO 4628-5. 7 days after the end of the exposure was evaluated adhesion strength by pull-off test.
Deviations from the standard:	none
Date of test:	- exposure: from 14 th November to 05 th December 2017 - pull-off test: 12 th December 2017
Test personnel:	Jozef Kukliš

Thermal change compatibility – ageing at 70°C - accredited test

Test procedure:	EN 1062-11: 2002 Paints and varnishes. Coating materials and coating systems for exterior masonry and concrete Part 11: Methods of conditioning before testing
Description of test specimens:	two treated concrete slabs with dimensions of 300 mm x 300 mm, thickness 100 mm, the coating applied on one face - test substrate: concrete Type MC (0,40) - application of coating: as described on page 1 - curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by:	Jozef Kukliš
Test conditions:	The test samples were subjected to aging at temperature 70°C over a period 7 days. Immediately after the end of the exposure was evaluated: - degree of blistering, method according to EN ISO 4628-2; - degree of cracking, method according to EN ISO 4628-4; - degree of flaking, method according to EN ISO 4628-5. 7 days after the end of the exposure was evaluated adhesion strength by pull-off test.
Deviations from the standard:	none
Date of test:	- exposure: from 14 th to 21 st November 2017 - pull-off test: 28 th November 2017
Test personnel:	Jozef Kukliš

Resistance to temperature shock - accredited test

Test procedure:	EN 13687-5: 2002 Products and systems for the protection and repair of concrete structures. Test methods. Determination of thermal compatibility. Part 5: Resistance to temperature shock
Description of test specimens:	two treated concrete slabs with dimensions of 400 mm x 400 mm, thickness 50 mm, the coating applied on one face - test substrate: concrete Type MC (0,40) - application of coating: as described on page 1 - curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by:	Jozef Kukliš
Test conditions:	- Testing liquid: silicone oil - Test temperature: +150°C Immediately after the end of the exposure was evaluated: - degree of blistering, method according to EN ISO 4628-2; - degree of cracking, method according to EN ISO 4628-4; - degree of flaking, method according to EN ISO 4628-5. 48 h after the end of the exposure was evaluated adhesion strength by pull-off test.
Deviations from the standard:	none
Date of test:	- exposure: 19 th November 2017 - pull-off test: 21 st November 2017
Test personnel:	Jozef Kukliš

Resistance to severe chemical attack - accredited test

Test procedure:	EN 13529: 2003 Products and systems for the protection and repair of concrete structures. Test methods. Resistance to severe chemical attack
Description of test specimens:	one treated concrete slab with dimensions of 300 mm x 300 mm, thickness 50 mm, the coating applied on one face - test substrate: concrete Type C (0,45) with a maximum size of aggregate of 8 mm - application of coating: as described on page 1 - curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by:	Jozef Kukliš
Test conditions:	- laboratory environment - the test duration: Class I: 3 days without pressure - used testing liquids: a) testing liquid for group 1. Petrol Composition of testing liquid in accordance to EN 13529, Table A1: - 47,5 % Vol.-% toluene - 30,4 % Vol.-% isooctane - 17,1 % Vol.-% n-heptane - 3,0 % Vol.-% methanol - 2,0 % Vol.-% tert.-butanol b) chlorinated water Testing solution was prepared according to EN 14891 with the addition of 200 mg/l sodium chloride and 200 mg/l sodium sulphate to fresh water. Immediately after the end of the exposure was evaluated: - degree of blistering, method according to EN ISO 4628-2; - degree of cracking, method according to EN ISO 4628-4; - degree of flaking, method according to EN ISO 4628-5 24 h after removal of the testing liquids the hardness was measured by Buchholz indentation test according to EN ISO 2815.
Deviations from the standard:	none
Date of test:	- exposure: from 22 nd to 25 th November 2017 - Buchholz indentation test: 26 th November 2017
Test personnel:	Jozef Kukliš

Impact resistance - accredited test

Test procedure:	EN ISO 6272-1: 2004 Paints and varnishes – Rapid-deformation (impact resistance) tests. Part 1: Falling-weight, large-area indenter
Description of test specimens:	one treated concrete slab with dimensions of 300 mm x 300 mm, thickness 50 mm, the coating applied on one face - test substrate: concrete Type MC (0,40) - application of coating: as described on page 1 - curing time after application: 14 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by:	Jozef Kukliš
Test conditions:	laboratory environment
Deviations from the standard:	none
Date of test:	14 th November 2017
Test personnel:	Jozef Kukliš

Adhesion strength by pull-off test - accredited test

Test procedure:	EN 1542: 1999 Products and systems for the protection and repair of concrete structures. Test methods. Measurement of bond strength by pull-off
Description of test specimens:	one treated concrete slab with dimensions of 300 mm x 300 mm, thickness 100 mm, the coating applied on one face - test substrate: concrete Type C (0,70) - application of coating: as described on page 1 - curing time after application: 7 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by:	Jozef Kukliš
Test conditions:	laboratory environment
Deviations from the standard:	none
Date of test:	19 th November 2017
Test personnel:	Jozef Kukliš

Behaviour after artificial atmospheric agents - accredited test

Test procedure:	EN 1062-11: 2002 Paints and varnishes. Coating materials and coating systems for exterior masonry and concrete. Part 11: Methods of conditioning before testing
Description of test specimens:	three treated test specimens with dimensions of 300 mm x 300 mm, coating applied to one face - test substrate: fibre cement board - application of coating: as described on page 1 - curing time after application: 14 days at (23±2)°C and (50±5)% relative humidity
Test specimens prepared by:	Jozef Kukliš
Test conditions:	The test samples were subjected for total exposure duration 2000 hours to UV-A radiation and humidity in accordance with STN EN 1062-11, Clause 4.2. Exposure consisted of the following cycles: - 4 h UV irradiation (dry phase) at a Black Standard Temperature (BST) of (60 ± 3)°C. Used laboratory light source: fluorescent lamps type 2 UV-A (340 nm) - 4 h wetting without UV radiation at a Black Standard Temperature (BST) of (50 ± 3)°C After 2000 h of the exposure were evaluated: - degree of blistering, method according to EN ISO 4628-2; - degree of cracking, method according to EN ISO 4628-4; - degree of flaking, method according to EN ISO 4628-5.
Deviations from the standard:	none
Date of test:	from 11 th November 2017 to 4 th February 2018
Test personnel:	Jozef Kukliš

Applied instrumentation:

ID	Name	Range	Unit	Division
M900007	Calliper	(0 - 250,00)	mm	0,01
M900008	Pull-off tester ERICHSEN 417	0 až 47,00	MPa	0,5
M900009	Balance Kern PRJ 6200-2NM	0 až 6200	g	0,01
M900011	Stopwatch	(0 - 1800)	s	0,1
M900018	Analytical balance Sartorius BP 300 S	(0 - 303,00)	g	0,0001
M900031	Digital calliper	(0 - 150,00)	mm	0,01
M900037	Coating thickness gauge PIG	0 až 2	mm	0,02
M900044	Automatic recorder of temperature and humidity	((-25) - 45) (15 - 95)	°C %	0,1 1,0
Z900001	Climatized chamber Vötsch VC 4034	-40 až +180	°C	0,1
Z900002	Laboratory ventilated oven STERIMAT 354.3	+20 až +250	°C	1
Z900015	Aluminium cups with free test area of 0,005 m ²			
Z900021	Falling-weight apparatus			
Z900023	Barometer	960 až 1040	hPa	1
Z900024	Desiccator			
Z900028	Test chamber CO ₂	+20 až +250	°C	1
Z900026	Buhholz hardness Tester			
Z900030	Equipment with radiant surface heater			
Z900029	Equipment for water sprinkler			
Z900034	Apparatus for artificial ageing Q-U-V tester			
Z600037	Programmable climatic cabinet			
Z900040	Steel-cylinder			
Z900045	Moulds for preparing concrete plates			
Z900047	Concrete mixer 125 l			
Z900050	Scarecrows electric table for compacting concrete			
Z900053	Magnifying glass - with a magnification of 10 x			
	Hot plate			

TEST RESULTS**1) Cross cut test**

Number of measurement	Thickness of coating (µm)	Classification degree
1	38	1
2	42	1
3	40	1

- complied the classification degree 1

2) Carbon dioxide permeability

Test specimen No.	Mean value of the test specimen thickness s (m)	Mass difference of two weighings at constant change of mass d_m (g)	Carbon dioxide permeability i (g/(m ² .d))	Diffusion-equivalent air layer thickness s_d (m)	Diffusion resistance number m (-)
1	0,000044	0,0107	2,10	117,76	2,68.10 ⁶
2	0,000048	0,0149	2,93	84,54	1,76.10 ⁶
3	0,000048	0,0123	2,42	102,43	2,13.10 ⁶
Average	0,000047	0,0126	2,48	101,57	2,19.10 ⁶
Extended uncertainty U			0,54	21,72	0,57.10 ⁶

3) Permeability to water vapour

Test specimen No.	Mean value of the test specimen thickness d (m)	Mass difference of two weighings at constant change of mass (g)	Rate of flow of water vapour G_{cs} (g/h)	Water-vapour transmission rate V (g/(m ² .d))	Water-vapour diffusion-equivalent air layer thickness s_d (m)	Water-vapour resistance factor m (-)
1	0,000042	0,0095	3,9583.10 ⁻⁴	1,9120	10,670	254040
2	0,000048	0,0093	3,8750.10 ⁻⁴	1,8715	10,900	227088
3	0,000042	0,0088	3,6667.10 ⁻⁴	1,7705	11,522	274343
Average	0,000044	0,00920	3,8333.10 ⁻⁴	1,8513	11,031	251824
Extended uncertainty U					1,215	37194,02

4) Capillary water absorption and water permeability water

Test specimen No.	Thickness of coating (µm)	Width of the test area (mm)	Length of the test area (mm)	Initial weight (g)	Weight after immersion test (g)	Weight increase (g)	Liquid water permeability w (kg/(m ² .h ^{0,5}))
1	30	132	150	1299,46	1300,20	0,74	0,008
2	39	135	150	1246,62	1247,28	0,66	0,007
3	34	130	154	1210,28	1211,13	0,85	0,009
Average	34	132	151	1252,12	1252,87	0,75	0,008
Extended uncertainty U							0,001

5) Thermal change compatibility**Thunder-shower cycling (10 cycles) and Freeze-thaw cycling with de-icing salt immersion (20 cycles)****5a) Visual assessment after exposure**

Test specimen No.	Degree of blistering STN EN ISO 4628-2	Degree of cracking STN EN ISO 4628-4	Degree of flaking STN EN ISO 4628-5
after 10 cycles of thunder-shower			
1	0 (S0)	0 (S0)	0 (S0)
2	0 (S0)	0 (S0)	0 (S0)
after 10 cycles of thunder-shower and 10 cycles freeze-thaw with de-icing salt immersion			
1	0 (S0)	0 (S0)	0 (S0)
2	0 (S0)	0 (S0)	0 (S0)
after 10 cycles of thunder-shower and 20 cycles freeze-thaw with de-icing salt immersion			
1	0 (S0)	0 (S0)	0 (S0)
2	0 (S0)	0 (S0)	0 (S0)

5b) Adhesion strength by pull-off test after exposure

Test specimen No. 1

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	2,6	A 100 %
2	2,7	A 100 %
3	2,4	A 100 %
4	2,4	A 100 %
5	2,8	A 100 %
Average	2,6	-
Extended uncertainty U		0,2

Note:
A - cohesion failure in concrete substrate

Test specimen No. 2

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	2,3	A 100 %
2	2,6	A 100 %
3	2,8	A 100 %
4	2,7	A 100 %
5	2,5	A 100 %
Average	2,6	-
Extended uncertainty U	0,2	

Note:
A - cohesion failure in concrete substrate

Average value of adhesion strength by pull-off test after exposure of two test specimens	2,6 N/mm²
--	-----------------------------

6) Thermal change compatibility Freeze-thaw cycling without de-icing salt impact (20 cycles)

6a) Visual assessment after exposure

Test specimen No.	Degree of blistering STN EN ISO 4628-2	Degree of cracking STN EN ISO 4628-4	Degree of flaking STN EN ISO 4628-5
after 10 cycles of freeze-thaw without de-icing salt immersion			
1	0 (S0)	0 (S0)	0 (S0)
2	0 (S0)	0 (S0)	0 (S0)
after 20 cycles of freeze-thaw without de-icing salt immersion			
1	0 (S0)	0 (S0)	0 (S0)
2	0 (S0)	0 (S0)	0 (S0)

6b) Adhesion strength by pull-off test after exposure

Test specimen No. 1

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	2,9	A 100 %
2	2,5	A 100 %
3	3,3	A 100 %
4	2,7	A 100 %
5	2,8	A 100 %
Average	2,8	-
Extended uncertainty U	0,3	

Note:
A - cohesion failure in concrete substrate

Test specimen No. 2

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	2,5	A 100 %
2	2,5	A 100 %
3	2,6	A 100 %
4	2,4	A 100 %
5	2,5	A 100 %
Average	2,5	-
Extended uncertainty U	0,1	

Note:
A - cohesion failure in concrete substrate

Average value of adhesion strength by pull-off test after exposure of two test specimens	2,7 N/mm²
--	-----------------------------

7) Thermal change compatibility – ageing at 70°C for 7 days

7a) Visual assessment after exposure

Test specimen No.	Degree of blistering STN EN ISO 4628-2	Degree of cracking STN EN ISO 4628-4	Degree of flaking STN EN ISO 4628-5
1	0 (S0)	0 (S0)	0 (S0)
2	0 (S0)	0 (S0)	0 (S0)

7b) Adhesion strength by pull-off test after exposure

Test specimen No. 1

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	2,8	A 100 %
2	3,1	A 100 %
3	2,8	A 100 %
4	2,9	A 100 %
5	3,0	A 100 %
Average	2,9	-
Extended uncertainty U	0,2	

Note:
A - cohesion failure in concrete substrate

Test specimen No. 2

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	2,8	A 100 %
2	3,0	A 100 %
3	2,6	A 100 %
4	2,9	A 100 %
5	2,8	A 100 %
Average	2,8	-
Extended uncertainty U	0,2	

Note:
A - cohesion failure in concrete substrate

Average value of adhesion strength by pull-off test after exposure of two test specimens	2,9 N/mm²
--	-----------------------------

8) Resistance to temperature shock

- Test temperature: +150°C

8a) Visual assessment after exposure

Test specimen No.	Degree of blistering STN EN ISO 4628-2	Degree of cracking STN EN ISO 4628-4	Degree of flaking STN EN ISO 4628-5
1	0 (S0)	0 (S0)	0 (S0)
2	0 (S0)	0 (S0)	0 (S0)

8b) Adhesion strength by pull-off test after exposure

Test specimen No. 1

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	2,3	A 100 %
2	2,4	A 100 %
3	2,6	A 100 %
4	2,6	A 100 %
5	2,4	A 100 %
Average	2,5	-
Extended uncertainty U	0,2	

Note:
A - cohesion failure in concrete substrate

Test specimen No. 2

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	2,7	A 100 %
2	2,9	A 100 %
3	2,4	A 100 %
4	2,6	A 100 %
5	2,5	A 100 %
Average	2,6	-
Extended uncertainty U	0,2	-

Note:
A - cohesion failure in concrete substrate

Average value of adhesion strength by pull-off test after exposure of two test specimens	2,6 N/mm²
--	-----------------------------

9) Resistance to severe chemical attack

- 3 days without pressure

9a) Testing liquids: group 1. Petrol according to EN 13529

Visual assessment

Number of measurement	Degree of blistering STN EN ISO 4628-2	Degree of cracking STN EN ISO 4628-4	Degree of flaking STN EN ISO 4628-5
1	0 (S0)	0 (S0)	0 (S0)

Buchholz indentation test

Number of measurement	Thickness of coating (μm)	Before exposure		After exposure	
		Length of indentation / (mm)	Resistance to indentation α _B (-)	Length of indentation / (mm)	Resistance to indentation α _B (-)
1	52	0,6	166,7	0,6	166,7
2		0,6	166,7	0,7	142,9
3		0,5	200,0	0,6	166,7
4		0,6	166,7	0,7	142,9
5		0,5	200,0	0,6	166,7
Average		0,6	180,0	0,6	157,2
Extended uncertainty U		0,05	16,9	0,05	12,1

9b) Testing liquids: chlorinated water

Visual assessment

Number of measurement	Degree of blistering STN EN ISO 4628-2	Degree of cracking STN EN ISO 4628-4	Degree of flaking STN EN ISO 4628-5
2	0 (S0)	0 (S0)	0 (S0)

Buchholz indentation test

Number of measurement	Thickness of coating (μm)	Before exposure		After exposure	
		Length of indentation / (mm)	Resistance to indentation α _B (-)	Length of indentation / (mm)	Resistance to indentation α _B (-)
1	52	0,6	166,7	0,6	166,7
2		0,6	166,7	0,6	166,7
3		0,6	166,7	0,6	166,7
4		0,5	200,0	0,6	166,7
5		0,6	166,7	0,6	166,7
Average		0,6	173,4	0,6	166,7
Extended uncertainty U		0,05	13,9	0,04	0,03

10) Impact resistance

Number of measurement	Impact resistance - the mass of the falling weight 1000 g		
	Height 60 cm	Height 62,5 cm	Height 65 cm
1	pass	pass	fail
2	pass	pass	fail
3	pass	pass	pass
4	pass	pass	fail
5	pass	pass	pass
Impact resistance: 6,13 Nm			

11) Adhesion strength by pull-off test

Number of measurement	Adhesion strength by pull-off (N/mm ²)	Type of Failure
1	3,4	A 100 %
2	3,1	A 100 %
3	2,9	A 100 %
4	2,9	A 100 %
5	3,5	A 100 %
Average	3,2	-
Extended uncertainty U	0,3	-

Note:
A - cohesion failure in concrete substrate

12) Behaviour after artificial atmospheric agents

Visual assessment after 2000 hours of UV irradiation and humidity

Test specimen No.	Degree of blistering STN EN ISO 4628-2	Degree of cracking STN EN ISO 4628-4	Degree of flaking STN EN ISO 4628-5
1	0 (S0)	0 (S0)	0 (S0)
2	0 (S0)	0 (S0)	0 (S0)
3	0 (S0)	0 (S0)	0 (S0)

Date of report: 06th February 2014

Prepared by: Ing. Erika Halčinová

Authorized by: 
Ing. Pavel Kazár
Head of Laboratory Branch



Notes:

- Unless the Test Laboratory makes the sampling, data on the manufacturer, its manufacturing plant and about the sampling are presented according to information provided by the client.
- Testing was carried out according to the Operational procedure No. PP-007 of the Test laboratory in compliance with the listed test procedure.
- The given extended uncertainty U is based on the standard uncertainty multiplied by the coverage factor k = 2, that in case of the normal distribution provides the reliability in the order of 95%.
- Presented results are relevant to the product sample only.
- This report shall not be reproduced except in full without written approval of the Test Laboratory.

_____ **End of test report** _____

NANO-CERAMIC®

WWW.NANO-CERAMIC.COM THE NEXT GENERATION COATINGS

Test Reports Thin Film Coatings



Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03593
 Page No. : 1 OF 3
 Date of Report : May 27,2022

Inclusive Shield EST

Prince Mohammad Bin Fahad Road Po Box 73414 Dammam Saudi Arabia

Product Name Provision Pro
Product Type Thin Film Coating
Product Color Transparent
Manufacturer PT NANOMATRIX LAB INTERNASIONAL
Buyer/Order No. PT NANOMATRIX LAB INTERNASIONAL
Product Submitted By PT NANOMATRIX LAB INTERNASIONAL
Date of Sample Received May 09, 2022
Date of Testing May 09, 2022~May 27, 2022

Remark The information mentioned in the above section and the following report content marks # are provided by Client.
 (Exclude Sample Name, Sample Submitted By, Test Witnessed By, Test Method, Number of test, Date of Sample Received and Date of Testing)

 The laboratory tests according to the test requests and samples provided by client, and the results are as follows:

Test Request : Pencil Hardness

Test Method : Please see attached pages

Test Result : Please see attached pages

----- 1 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

Signed for and on behalf of
 SGS Taiwan Ltd.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan/811637高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisv-tw huano

2007

TWD 5467738



Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03593
 Page No. : 2 OF 3
 Date of Report : May 27,2022

Test Equipment :

Name	Brand	Model
Motorized Pencil Hardness Tester	Prema	P-247

Lab Environmental Conditions :

Ambient Temperature : (23 ± 2) °C
 Relative humidity : (50 ± 10) %

Test Method :

Refer to ASTM D3363-20 Standard Test Method for Film Hardness by Pencil Test

Test Conditioning :

Test Loads : 1000 g

Test Result :

Test Item	Test Result Provision Pro
Pencil hardness	
Scratch	B
Gouge	9H

Note : 1.The testing specimens are made and provided by client.
 2.Test location is the same as the laboratory address.

----- 3 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan/811637高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

TWD 5467739



Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03593
 Page No. : 1 OF 3
 Date of Report : May 27,2022

Inclusive Shield EST

Prince Mohammad Bin Fahad Road Po Box 73414 Dammam Saudi Arabia

Product Name Provision Pro
Product Type Thin Film Coating
Product Color Transparent
Manufacturer PT NANOMATRIX LAB INTERNASIONAL
Buyer/Order No. PT NANOMATRIX LAB INTERNASIONAL
Product Submitted By PT NANOMATRIX LAB INTERNASIONAL
Date of Sample Received May 09, 2022
Date of Testing May 09, 2022~May 27, 2022
Remark The information mentioned in the above section and the following report content marks # are provided by Client.
 (Exclude Sample Name, Sample Submitted By, Test Witnessed By, Test Method, Number of test, Date of Sample Received and Date of Testing)

 The laboratory tests according to the test requests and samples provided by client, and the results are as follows:

Test Request : Pencil Hardness

Test Method : Please see attached pages

Test Result : Please see attached pages

----- 1 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

Signed for and on behalf of
 SGS Taiwan Ltd.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan / 811637 高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw huang



Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03592
 Page No. : 1 OF 3
 Date of Report : May 27,2022

Inclusive Shield EST

Prince Mohammad Bin Fahad Road Po Box 73414 Dammam Saudi Arabia

Product Name Provision Diamond
Product Type Thin Film Coating
Product Color Transparent
Manufacturer PT NANOMATRIX LAB INTERNASIONAL
Buyer/Order No. PT NANOMATRIX LAB INTERNASIONAL
Product Submitted By PT NANOMATRIX LAB INTERNASIONAL
Date of Sample Received May 09, 2022
Date of Testing May 09, 2022~May 27, 2022
Remark The information mentioned in the above section and the following report content marks # are provided by Client.
 (Exclude Sample Name, Sample Submitted By, Test Witnessed By, Test Method, Number of test, Date of Sample Received and Date of Testing)

 The laboratory tests according to the test requests and samples provided by client, and the results are as follows:

Test Request : Pencil Hardness

Test Method : Please see attached pages

Test Result : Please see attached pages

----- 1 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

Signed for and on behalf of
 SGS Taiwan Ltd.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan / 811637 高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw huang

SGS

Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03592
 Page No. : 2 OF 3
 Date of Report : May 27,2022

Test Equipment :

Name	Brand	Model
Motorized Pencil Hardness Tester	Prema	P-247

Lab Environmental Conditions :

Ambient Temperature : (23 ± 2) °C
 Relative humidity : (50 ± 10) %

Test Method :

Refer to ASTM D3363-20 Standard Test Method for Film Hardness by Pencil Test

Test Conditioning :

Test Loads : 1000 g

Test Result :

Test Item	Test Result Provision Diamond
Pencil hardness	
Scratch	B
Gouge	9H

Note : 1.The testing specimens are made and provided by client.
 2.Test location is the same as the laboratory address.

----- 3 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan /811637 高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 ☎(886-7) 301-2121 ☎(886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisv-tw huan

SGS


Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03592
 Page No. : 3 OF 3
 Date of Report : May 27,2022

Sample Photo :

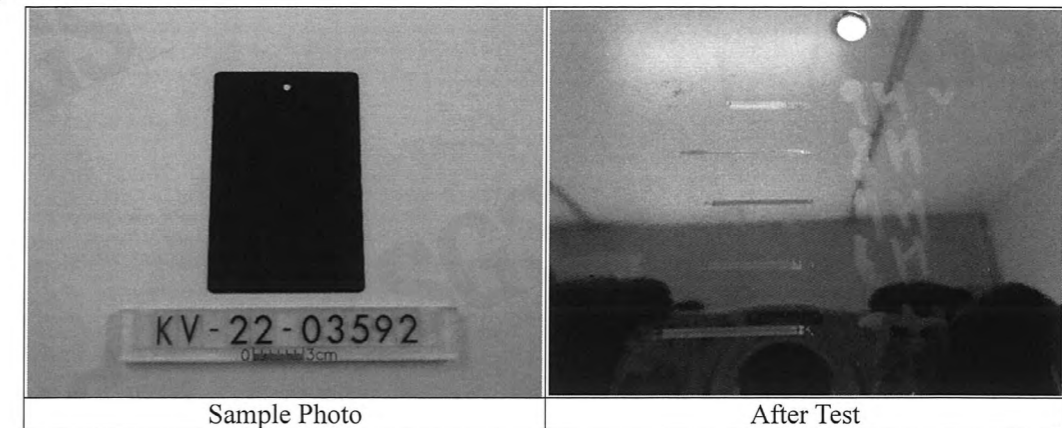

Sample Photo

After Test

----- oOo -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan /811637 高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 ☎(886-7) 301-2121 ☎(886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw_huang

SGS

Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03591
 Page No. : 1 OF 3
 Date of Report : May 27,2022

Inclusive Shield EST

Prince Mohammad Bin Fahad Road Po Box 73414 Dammam Saudi Arabia

Product Name Provision Basecoat
Product Type Thin Film Coating
Product Color Transparent
Manufacturer PT NANOMATRIX LAB INTERNASIONAL
Buyer/Order No. PT NANOMATRIX LAB INTERNASIONAL
Product Submitted By PT NANOMATRIX LAB INTERNASIONAL
Date of Sample Received May 09, 2022
Date of Testing May 09, 2022~May 27, 2022
Remark The information mentioned in the above section and the following report content marks # are provided by Client.
 (Exclude Sample Name, Sample Submitted By, Test Witnessed By, Test Method, Number of test, Date of Sample Received and Date of Testing)

=====

The laboratory tests according to the test requests and samples provided by client, and the results are as follows:

Test Request : Pencil Hardness

Test Method : Please see attached pages

Test Result : Please see attached pages

----- 1 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

Signed for and on behalf of
 SGS Taiwan Ltd.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan /811637 高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw_huang

SGS

Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03591
 Page No. : 2 OF 3
 Date of Report : May 27,2022

Test Equipment :

Name	Brand	Model
Motorized Pencil Hardness Tester	Prema	P-247

Lab Environmental Conditions :

Ambient Temperature : (23 ± 2) °C

Relative humidity : (50 ± 10) %

Test Method :

Refer to ASTM D3363-20 Standard Test Method for Film Hardness by Pencil Test

Test Conditioning :

Test Loads : 1000 g

Test Result :

Test Item	Test Result
	Provision Basecoat
Pencil hardness	
Scratch	HB
Gouge	9H

Note : 1. The testing specimens are made and provided by client.

2. Test location is the same as the laboratory address.

----- 3 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan /811637 高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw_huang

SGS

Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03591
 Page No. : 3 OF 3
 Date of Report : May 27,2022

Sample Photo :



----- oOo -----



Attn. There are people who say that they have 10H Hardness please notice that the certificates if have any are manipulated. as there are no harness pencils to test this.

H

Huang, Belinda (Kaohsiung City)

to Chris, Alice-ME, Tommy, Max, Maxine, me ▾

Hi Wim,

We don't have a 10H pencil so that is unable to test.

Thanks for your email

...

Best Regards,

Belinda HUANG黃碩君

Industries and Environment

Industrial

Material & Engineering Lab. Polymer Lab.-Kaohsiung

Supervisor-Marketing

SGS Taiwan Ltd.

61, Kai Fa Road, Kaohsiung Nanzih Techology Industrial park,

Kaohsiung 81170, Taiwan (R.O.C.)

高雄市81170楠梓產業科技園區開發路61號

Phone :+886 7 301 2121 Ext.1407

Fax: +886 7 301 1197

Mobile :+886 976037840

E-mail : Belinda.Huang@sgs.com

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan /811637高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw_huang

TWD 5467734

2007



Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03593
 Page No. : 1 OF 3
 Date of Report : May 27,2022

Inclusive Shield EST

Prince Mohammad Bin Fahad Road Po Box 73414 Dammam Saudi Arabia

Product Name Provision Pro
Product Type Thin Film Coating
Product Color Transparent
Manufacturer PT NANOMATRIX LAB INTERNASIONAL
Buyer/Order No. PT NANOMATRIX LAB INTERNASIONAL
Product Submitted By PT NANOMATRIX LAB INTERNASIONAL
Date of Sample Received May 09, 2022
Date of Testing May 09, 2022~May 27, 2022

Remark The information mentioned in the above section and the following report content marks # are provided by Client.
 (Exclude Sample Name, Sample Submitted By, Test Witnessed By, Test Method, Number of test, Date of Sample Received and Date of Testing)

 The laboratory tests according to the test requests and samples provided by client, and the results are as follows:

Test Request : Pencil Hardness

Test Method : Please see attached pages

Test Result : Please see attached pages

----- 1 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

Signed for and on behalf of
 SGS Taiwan Ltd.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan / 811637 高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisv-tw huano



Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03593
 Page No. : 2 OF 3
 Date of Report : May 27,2022

Test Equipment :

Name	Brand	Model
Motorized Pencil Hardness Tester	Prema	P-247

Lab Environmental Conditions :

Ambient Temperature : (23 ± 2) °C
 Relative humidity : (50 ± 10) %

Test Method :

Refer to ASTM D3363-20 Standard Test Method for Film Hardness by Pencil Test

Test Conditioning :

Test Loads : 1000 g

Test Result :

Test Item	Test Result Provision Pro
Pencil hardness	
Scratch	B
Gouge	9H

Note : 1.The testing specimens are made and provided by client.
 2.Test location is the same as the laboratory address.

----- 3 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan / 811637 高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw



Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03593
Page No. : 1 OF 3
Date of Report : May 27,2022

Inclusive Shield EST

Prince Mohammad Bin Fahad Road Po Box 73414 Dammam Saudi Arabia

Product Name Provision Pro
Product Type Thin Film Coating
Product Color Transparent
Manufacturer PT NANOMATRIX LAB INTERNASIONAL
Buyer/Order No. PT NANOMATRIX LAB INTERNASIONAL
Product Submitted By PT NANOMATRIX LAB INTERNASIONAL
Date of Sample Received May 09, 2022
Date of Testing May 09, 2022~May 27, 2022

Remark The information mentioned in the above section and the following report content marks # are provided by Client. (Exclude Sample Name, Sample Submitted By, Test Witnessed By, Test Method, Number of test, Date of Sample Received and Date of Testing)

The laboratory tests according to the test requests and samples provided by client, and the results are as follows:

Test Request : Pencil Hardness

Test Method : Please see attached pages

Test Result : Please see attached pages

----- 1 -----

Signed for and on behalf of
SGS Taiwan Ltd.

The required specification(s) offered in this test report is/are for reference only. The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com.tw/Terms-and-Conditions and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at http://www.sgs.com.tw/Terms-and-Conditions. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan /811637高雄市楠梓區開發路61號
台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw huang



Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03592
Page No. : 1 OF 3
Date of Report : May 27,2022

Inclusive Shield EST

Prince Mohammad Bin Fahad Road Po Box 73414 Dammam Saudi Arabia

Product Name Provision Diamond
Product Type Thin Film Coating
Product Color Transparent
Manufacturer PT NANOMATRIX LAB INTERNASIONAL
Buyer/Order No. PT NANOMATRIX LAB INTERNASIONAL
Product Submitted By PT NANOMATRIX LAB INTERNASIONAL
Date of Sample Received May 09, 2022
Date of Testing May 09, 2022~May 27, 2022

Remark The information mentioned in the above section and the following report content marks # are provided by Client. (Exclude Sample Name, Sample Submitted By, Test Witnessed By, Test Method, Number of test, Date of Sample Received and Date of Testing)

The laboratory tests according to the test requests and samples provided by client, and the results are as follows:

Test Request : Pencil Hardness

Test Method : Please see attached pages

Test Result : Please see attached pages

----- 1 -----

Signed for and on behalf of
SGS Taiwan Ltd.

The required specification(s) offered in this test report is/are for reference only. The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com.tw/Terms-and-Conditions and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at http://www.sgs.com.tw/Terms-and-Conditions. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan /811637高雄市楠梓區開發路61號
台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw huang

SGS

Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03593
 Page No. : 1 OF 3
 Date of Report : May 27,2022

Inclusive Shield EST

Prince Mohammad Bin Fahad Road Po Box 73414 Dammam Saudi Arabia

Product Name Provision Pro
Product Type Thin Film Coating
Product Color Transparent
Manufacturer PT NANOMATRIX LAB INTERNASIONAL
Buyer/Order No. PT NANOMATRIX LAB INTERNASIONAL
Product Submitted By PT NANOMATRIX LAB INTERNASIONAL
Date of Sample Received May 09, 2022
Date of Testing May 09, 2022~May 27, 2022

Remark The information mentioned in the above section and the following report content marks # are provided by Client.
 (Exclude Sample Name, Sample Submitted By, Test Witnessed By, Test Method, Number of test, Date of Sample Received and Date of Testing)

 The laboratory tests according to the test requests and samples provided by client, and the results are as follows:

Test Request : Pencil Hardness

Test Method : Please see attached pages

Test Result : Please see attached pages

----- 1 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

Signed for and on behalf of
 SGS Taiwan Ltd.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan/811637高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisv-tw huano

SGS

Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03593
 Page No. : 2 OF 3
 Date of Report : May 27,2022

Test Equipment :

Name	Brand	Model
Motorized Pencil Hardness Tester	Prema	P-247

Lab Environmental Conditions :

Ambient Temperature : (23 ± 2) °C
 Relative humidity : (50 ± 10) %

Test Method :

Refer to ASTM D3363-20 Standard Test Method for Film Hardness by Pencil Test

Test Conditioning :

Test Loads : 1000 g

Test Result :

Test Item	Test Result Provision Pro
Pencil hardness	
Scratch	B
Gouge	9H

Note : 1.The testing specimens are made and provided by client.
 2.Test location is the same as the laboratory address.

----- 3 -----

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan/811637高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisv-tw huano

SGS


Material and Engineering Laboratory-Kaohsiung

Test Report



Report No. : KV-22-03591
 Page No. : 3 OF 3
 Date of Report : May 27,2022

Sample Photo :

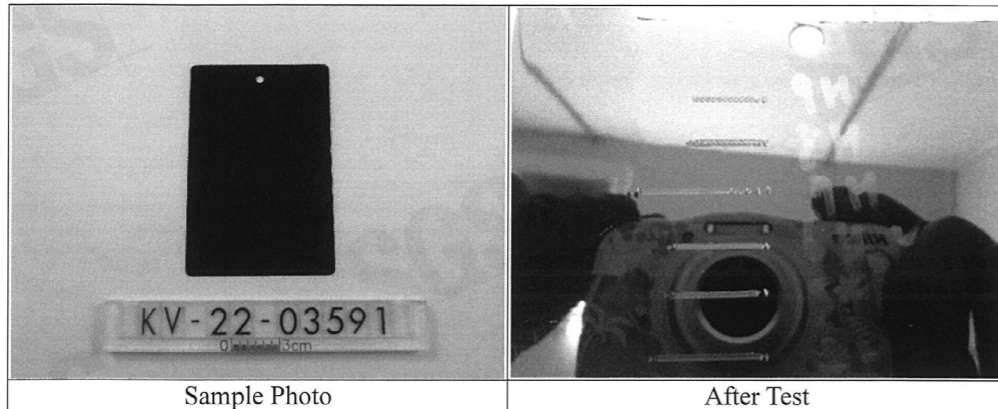

----- oOo -----



Attn. There are people who say that they have 10H Hardness please notice that the certificates if have any are manipulated. as there are no harness pencils to test this.



Huang, Belinda (Kaohsiung City)

to Chris, Alice-ME, Tommy, Max, Maxine, me ▾

Hi Wim,

We don't have a 10H pencil so that is unable to test.

Thanks for your email

...

Best Regards,

Belinda HUANG黃碩君

Industries and Environment

Industrial

Material & Engineering Lab. Polymer Lab.-Kaohsiung

Supervisor-Marketing

SGS Taiwan Ltd.

61, Kai Fa Road, Kaohsiung Nanzih Techology Industrial park,

Kaohsiung 81170, Taiwan (R.O.C.)

高雄市81170楠梓產業科技園區開發路61號

Phone :+886 7 301 2121 Ext.1407

Fax: +886 7 301 1197

Mobile :+886 976037840

E-mail : Belinda.Huang@sgs.com

The required specification(s) offered in this test report is/are for reference only.
 The conformity judgment is at the Applicant's final verdict.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.

SGS Taiwan Ltd. No.61, Kai Fa Rd., Nanzih District, Kaohsiung City 811637, Taiwan /811637高雄市楠梓區開發路61號
 台灣檢驗科技股份有限公司 t (886-7) 301-2121 f (886-7) 301-1165 www.sgs.com.tw

Member of SGS Group

daisy-tw_huang

TWD 5467734

2007

NANO-CERAMIC®

WWW.NANO-CERAMIC.COM THE NEXT GENERATION COATINGS

*The Leader
in
Durability*

Head Office

PT Nano Ceramic International
Ruko Inkopal, Jl. Boulevard Barat
Blok B No.5-6, Kelapa Gading, Jakarta Utara,
14240, Indonesia

automotive@nano-ceramic.com